


704 sq. feet



803 combined sq. feet

- WALL LEGEND**
- 1 HR RATED OCCUPANCY SEPARATION WALL - SEE 2/A0.02 FOR SYSTEM DESCRIPTION
 - 1 HR RATED CORRIDOR SEE 2/A0.02 FOR SYSTEM DESCRIPTION
 - EXISTING WALLS
 - METAL STUD WALLS

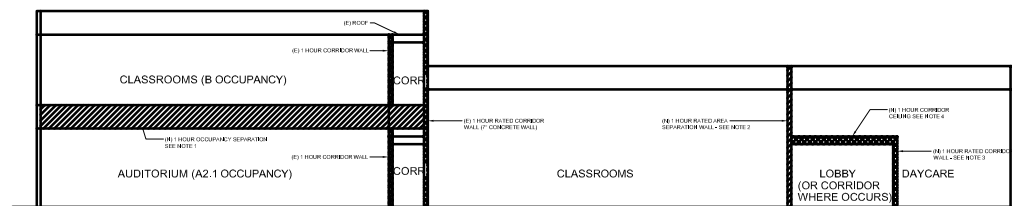

- NOTES:**
1. PROVIDE 1 HOUR RATED FLOOR-CEILING ASSEMBLY PER GYPSUM ASSOCIATION FILE NO. FC 5410, CONSISTING OF ONE LAYER 1/2" TYPE X GYPSUM BOARD (NEW) APPLIED AT RIGHT ANGLES TO MIN. 2 X 10 WOOD JOISTS 16" ON CENTER (EXISTING) WITH 5D NAILS, 1-5/8" LONG, 0.099" SHANK, 1/4" HEADS, AT 6" ON CENTER, NAILS PLACED 3/4" FROM BOARD EDGE JOINTS AND 1/2" FROM BOARD END JOINTS. WOOD JOISTS ARE SUPPORTING 1-1/4" THICK PLYWOOD SUBFLOOR (EXISTING).
 2. PROVIDE 1 HOUR RATED OCCUPANCY SEPARATION WALL PER GYPSUM ASSOCIATION FILE NO. WP 1200 CONSISTING OF ONE LAYER 5/8" TYPE X GYPSUM BOARD APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 3-5/8" OR 6" STEEL STUDS 24" ON CENTER WITH 1" TYPE S DRYWALL SCREWS 8" ON CENTER AT VERTICAL JOINTS AND 12" ON CENTER AT FLOOR AND CEILING RUNNERS AND INTERMEDIATE STUDS. JOINTS STAGGERED 24" ON OPPOSITE SIDES. EXTEND WALL FROM FLOOR SLAB TO UNDERSIDE OF ROOF PLYWOOD.
 3. PROVIDE 1 HOUR RATED CORRIDOR WALL PER GYPSUM ASSOCIATION FILE NO. WP 1200 CONSISTING OF ONE LAYER 5/8" TYPE X GYPSUM BOARD APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 3-5/8" OR 6" STEEL STUDS 24" ON CENTER WITH 1" TYPE S DRYWALL SCREWS 8" ON CENTER AT VERTICAL JOINTS AND 12" ON CENTER AT FLOOR AND CEILING RUNNERS AND INTERMEDIATE STUDS. JOINTS STAGGERED 24" ON OPPOSITE SIDES. EXTEND WALL FROM FLOOR TO 1 HOUR RATED CORRIDOR CEILING CONSTRUCTION.
 4. PROVIDE 1 HOUR RATED CORRIDOR CEILING PER GYPSUM ASSOCIATION FILE NO. WP 1200 CONSISTING OF ONE LAYER 5/8" TYPE X GYPSUM BOARD APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 3-5/8" OR 6" STEEL STUDS 24" ON CENTER WITH 1" TYPE S DRYWALL SCREWS 8" ON CENTER AT VERTICAL JOINTS AND 12" ON CENTER AT FLOOR AND CEILING RUNNERS AND INTERMEDIATE STUDS. JOINTS STAGGERED 24" ON OPPOSITE SIDES. EXTEND CEILING FROM 1 HOUR RATED WALL TO 1 HOUR RATED WALL.

2 CONCEPTUAL BUILDING SECTION

N.T.S.

	A-3	B (CR)	B(Office)	B(Kitchen)	S-2
First Floor					
Cafeteria	3437			1379	
Kitchen					
Classroom		2438			
Storage Room					645
Warehouse					4520
Open Office			1081		
Office			160		
Office			100		
Reception			0		
Office			404		
Break Room					
Second Floor					
Classroom		709			
Classroom		842			
Classroom		1005			
Classroom		994			
Classroom		707			
Office					
Office		118			
Office		93			
Office		89			
Office		220			
Office		148			
Office		144			
Office		149			
Office		144			
Office		221			
Conf Rm					
Break Rm					

Square Feet	3437	6695	3071	1379	5165
Factor	30	50	200	200	5000
Occupants	115	134	16	7	2
Male Occupants	58	67	8	4	1
WC	Factor 1:1-100	1:40	1:1-15	1:1-15	1:1-10
Fixtures	1	2	1	1	1
UR	Factor 1:50	1:35	0:1-9	0:1-9	0:1-9
Fixtures	2	2	0	0	0
LAV	Factor 1:40	1:40	1:40	1:40	1:10
Fixtures	2	2	1	1	1
Female Occupants	58	67	8	4	1
WC	Factor 4:51-100	1:30	1:1-15	1:1-15	1:1-10
Fixtures	4	3	1	1	1
LAV	Factor 1:40	1:40	1:40	1:40	1:10
Fixtures	2	2	1	1	1
DF	Factor 1:150	1:150			1:150
Fixtures	1	1			1

3 MINIMUM PLUMBING FIXTURE CALCULATION

N.T.S.

BILL GOULD DESIGN
ART & ARCHITECTURE
394-A Umberger Rd.
San Jose, CA 95111
Fax 408.224.9891
Phone 408.224.9890



General Notes

Key Plan

DAYCARE AND ADULT EDUCATION FACILITY
SAN JOSE CONSERVATION CORPS

1560 BERGER DRIVE
SAN JOSE CA

No	Revisions/Submissions	Date
3	Daycare Revisions	3.22.08
4	Daycare Revisions	3.22.08
5	Field Conditions Revisions	05.18.09
6	Field Conditions Revisions	11.03.09

Drawing Title

CODE PLAN
SECOND FLOOR

Regulatory Agency Approval

Architect Seal



Project No.
94017

Date
06.31.07

Drawing No.
A0.02

1 SECOND FLOOR PLAN

3/32" = 1'-0"

3

N.T.S.